


XX XX
ID: XX Page: Acq Test Date: May. 30, 2024 DOB: Age: (DOB empty) Report: May. 30, 2024
Acquisition Page



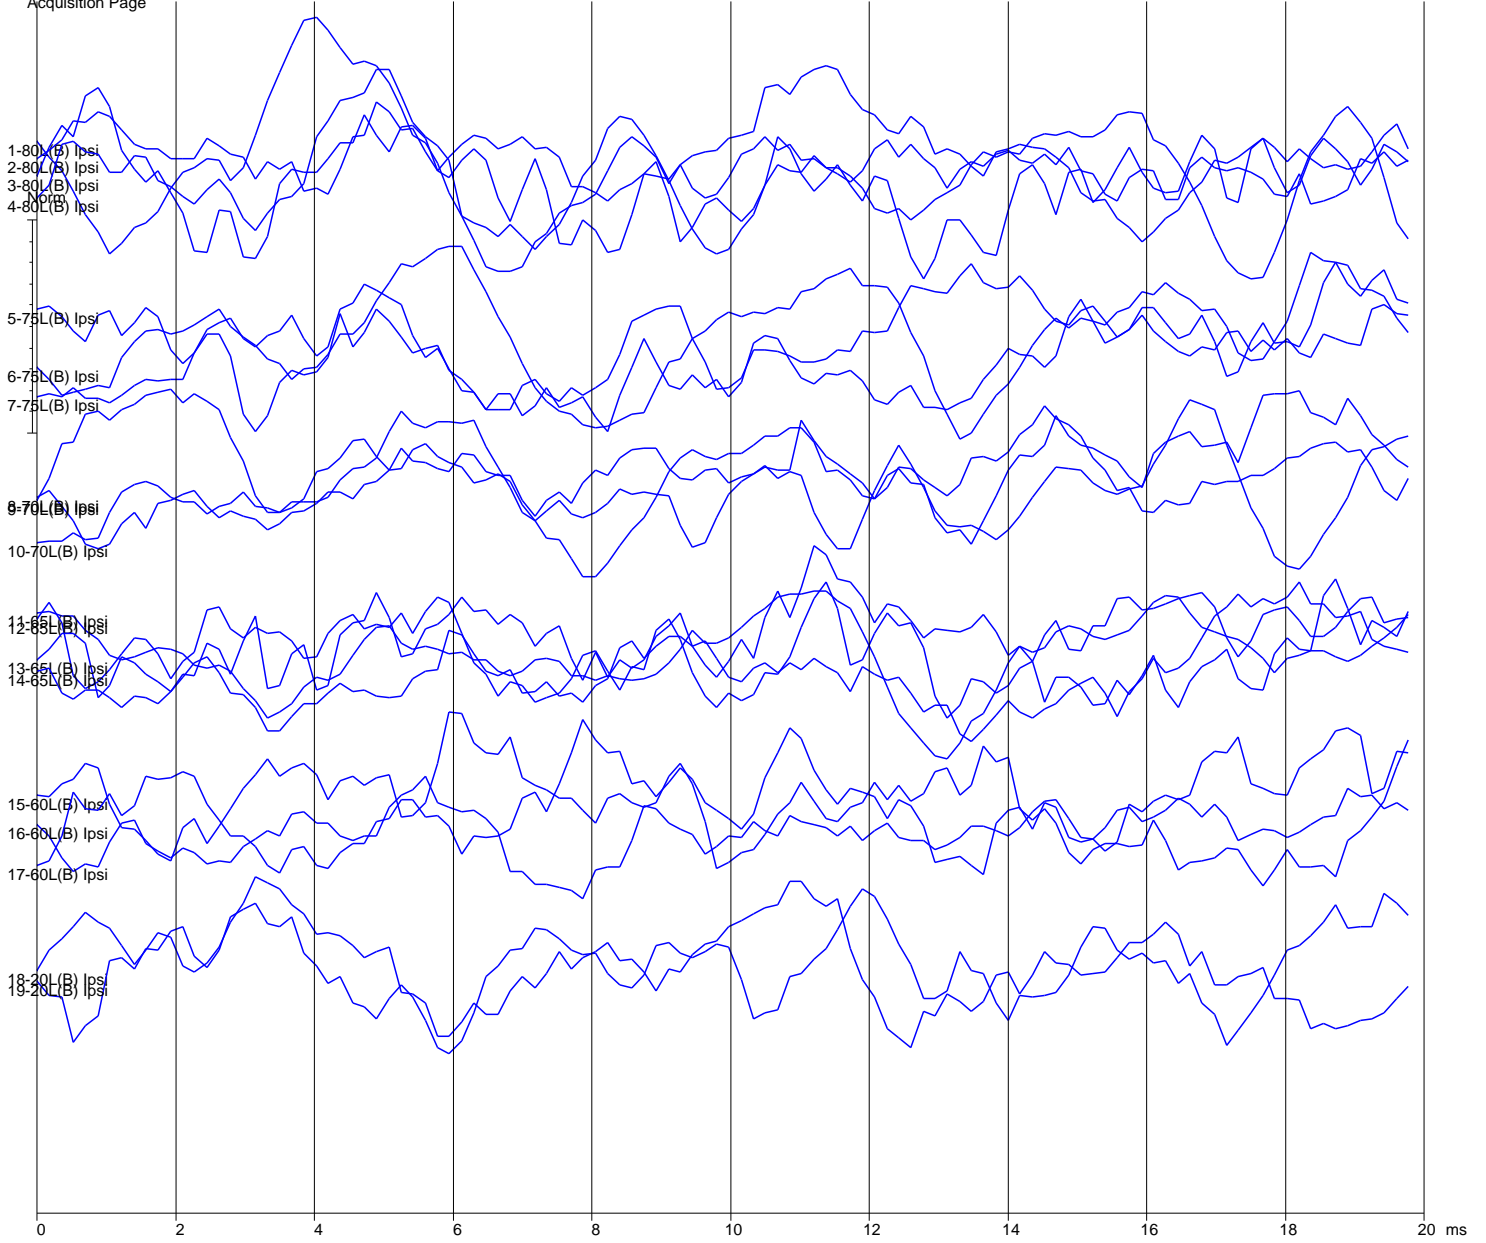

6860 SW 81st Street Miami, Florida 33143
 305-668-6102 • 1-800-IHSYSTEMS • www.ihsys.com


XX XX
 ID: XX Page: Acq Test Date: May. 30, 2024 DOB: Age: (DOB empty) Report: May. 30, 2024
 Acquisition Page

Num	Filename	Int	Ear	Stim.	Type	Swps/Art	Rate	Mode	PP Amp	SNR RN	Gain	Filters
1	NXLA80B.2	80SPL	L	Bone	6000Hz(1)	560/0	11.4	Altr	0.41	0.06 5.087	100	100-1500Hz
2	NXLA80B.3	80SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.30	0.01 5.381	100	100-1500Hz
3	NXLA80B.4	80SPL	L	Bone	6000Hz(1)	560/0	11.4	Altr	0.23	0.02 5.258	100	100-1500Hz
4	NXLA80B.1	80SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.30	0.03 5.182	100	100-1500Hz
5	NXLA75B.3	75SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.24	0.03 2.928	100	100-1500Hz
6	NXLA75B.2	75SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.42	0.09 2.811	100	100-1500Hz
7	NXLA75B.1	75SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.23	0.02 2.870	100	100-1500Hz
8	NXLA70B.4	70SPL	L	Bone	6000Hz(1)	560/0	11.4	Altr	0.45	0.05 1.717	100	100-1500Hz
9	NXLA70B.2	70SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.32	0.09 1.809	100	100-1500Hz
10	NXLA70B.3	70SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.27	0.03 1.582	100	100-1500Hz
11	NXLA65B.2	65SPL	L	Bone	6000Hz(1)	560/0	11.4	Altr	0.61	0.09 1.068	100	100-1500Hz
12	NXLA65B.1	65SPL	L	Bone	6000Hz(1)	560/0	11.4	Altr	0.21	0.06 1.066	100	100-1500Hz
13	NXLA65B.4	65SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.21	0.05 0.935	100	100-1500Hz
14	NXLA65B.3	65SPL	L	Bone	6000Hz(1)	560/0	11.4	Altr	0.26	0.05 0.912	100	100-1500Hz
15	NXLA60B.1	60SPL	L	Bone	6000Hz(1)	560/0	11.4	Altr	0.20	0.09 0.574	100	100-1500Hz
16	NXLA60B.3	60SPL	L	Bone	6000Hz(1)	560/0	11.4	Altr	0.31	0.19 0.518	100	100-1500Hz
17	NXLA60B.2	60SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.19	0.13 0.525	100	100-1500Hz
18	NXLA20B.2	20SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.33	0.54 0.183	100	100-1500Hz
19	NXLA20B.1	20SPL	L	Bone	6000Hz(1)	560/1	11.4	Altr	0.37	0.66 0.177	100	100-1500Hz

System SNR & RN Region: 4.00 - 9.00 ms *-indicates different region used

Num	Int	Ear	Peaks: Latency(ms) Amp(uV) (AR=Amp Ratio)
1	80	L	
2	80	L	
3	80	L	
4	80	L	
5	75	L	
6	75	L	
7	75	L	
8	70	L	
9	70	L	
10	70	L	
11	65	L	
12	65	L	
13	65	L	
14	65	L	
15	60	L	
16	60	L	
17	60	L	
18	20	L	
19	20	L	

XX XX
 ID: XX Page: 1 Test Date: May. 30, 2024 DOB: Age: (DOB empty) Report: May. 30, 2024
 Page 1

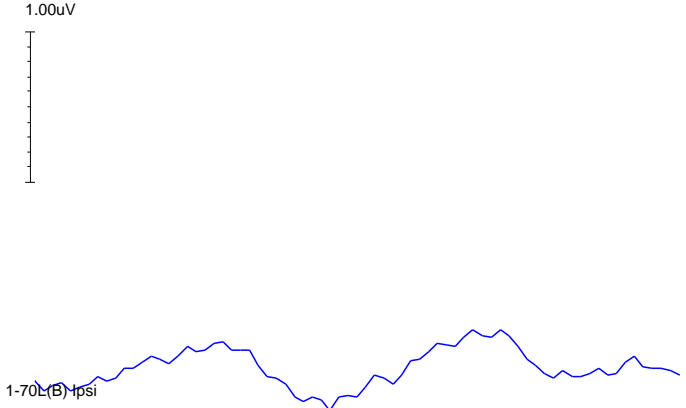

Num	Filename	Int	Ear	Stim. Type	Swps/Art	Rate	Mode	PP Amp	SNR RN	Gain	Filters
1	NXLA70B.1	70SPL	L	Bone 6000Hz(1)	560/1	11.4	Altr	0.54	0.17 1.765	100	100-1500Hz

System SNR & RN Region: 4.00 - 9.00 ms *-indicates different region used

Num Int Ear Peaks: Latency(ms) | Amp(uV) (AR=Amp Ratio)
 1 70 L